


ReadValue / PLC_1 [CPU 1211C AC/DC/Rly] / Program blocks

CalcScreeResultFB [FB1]

CalcScreeResultFB Properties							
General							
Name	CalcScreeResultFB	Number	1	Type	FB	Language	LAD
Numbering	automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					

CalcScreeResultFB							
Name	Data type	Offset	Default value	Accessible from HMI	Visible in HMI	Setpoint	Comment
▼ Input							
Req	Bool	0.0	false	True	True	False	
Result	Int	2.0	0	False	False	False	
UnitDP	Int	4.0	0	True	True	False	
▼ Output							
RValue	Real	6.0	0.0	False	False	False	
InOut							
Static							
▼ Temp							
LSB	Int	0.0					
MSB	Int	2.0					
DivideValue	Int	4.0					
tempValue	Real	6.0					
▼ Constant							
Mask	Byte		255				

Network 1:

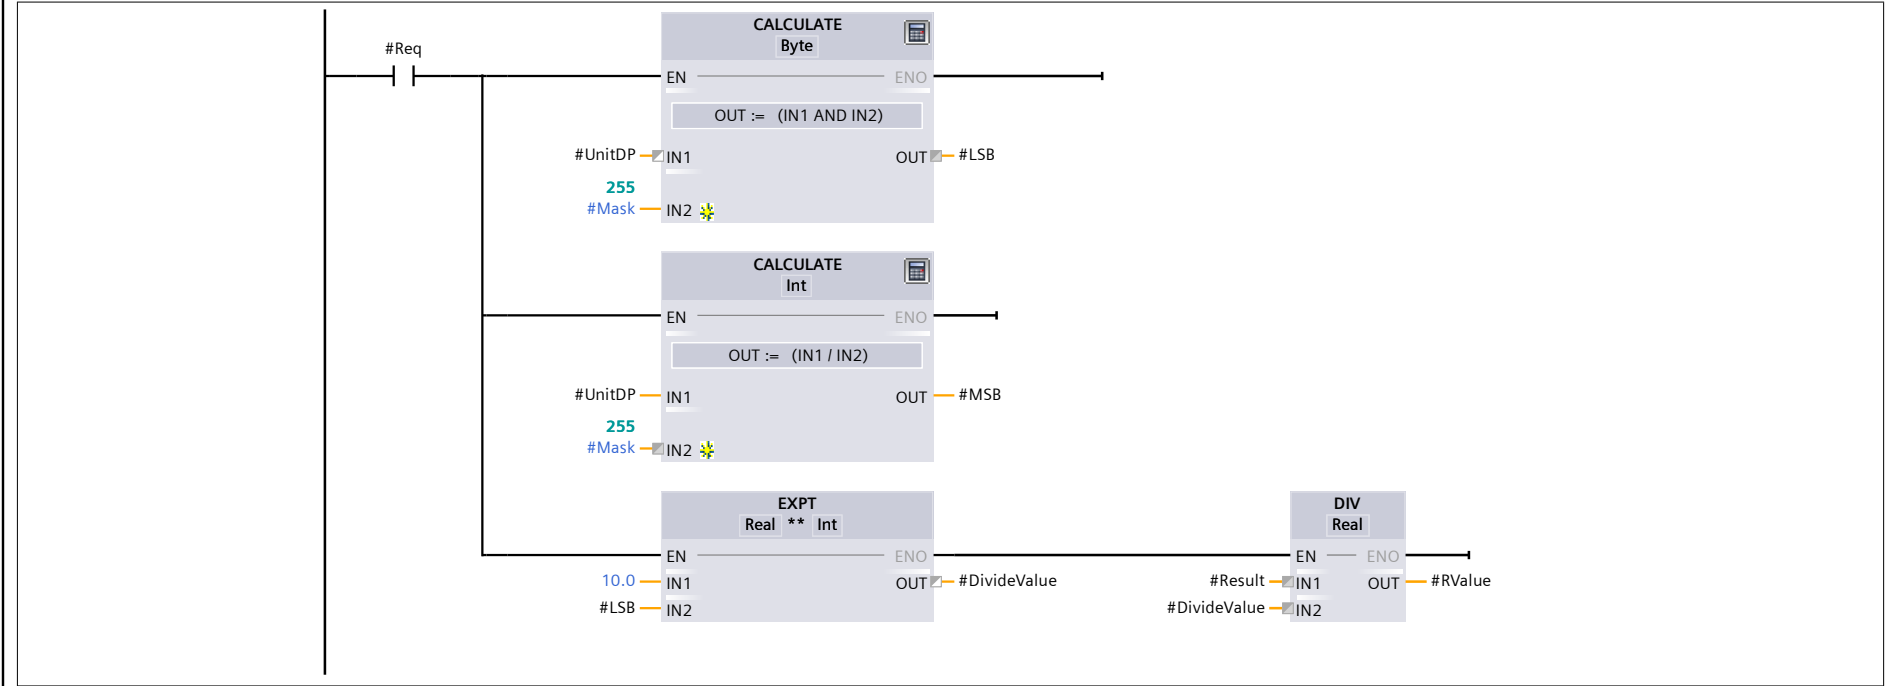

Symbol	Address	Type	Comment
#DivideValue		Int	
#LSB		Int	
#Mask	255	Byte	
#MSB		Int	
#Req		Bool	
#Result		Int	
#RValue		Real	
#UnitDP		Int	